

**Asbestos Abatement Work Plan
Former Gas Administration Building,
25 Cimino Drive/101 Conejos
Colorado Springs, Colorado**

WALSH Project Number: 900586.0001.010
November 4, 2009



**ASBESTOS ABATEMENT WORK PLAN
FORMER GAS ADMINISTRATION BUILDING
25 Cimino Drive/101 Conejos
COLORADO SPRINGS, COLORADO**

November 4, 2009

Prepared for: Ms. Joann Cox
City of Colorado Springs
Business Dev Admin Tech
City Hall, Suite 100 (Garden Level)
Colorado Springs, CO 80903

c/o Ms. Kim Hurley
Environmental Specialist
Colorado Springs Utilities
Colorado Springs, Colorado



Prepared by:

Christopher J. Thompson
Certified Asbestos Inspector/Designer



Reviewed by:

Daniel M. Benecke
Certified Asbestos Inspector/Designer

Submitted by
WALSH ENVIRONMENTAL SCIENTISTS AND ENGINEERS, LLC.
130 East Kiowa, Suite 202
Colorado Springs, Colorado 80903
(719) 227-0999
www.walshenv.com
WALSH Project Number: 900586.0001.010

TABLE OF CONTENTS

1	INTRODUCTION.....	2
2	ASBESTOS-CONTAINING MATERIALS.....	2
3	GENERAL HAZARDOUS MATERIALS.....	2
4	SCOPE OF WORK.....	5
5	SCHEDULE.....	7
6	WORK PROCEDURES.....	7
7	INSPECTIONS BY OWNER/OWNERS REPRESENTATIVE.....	8
8	MAXIMUM ALLOWABLE ASBESTOS LEVEL (MAAL).....	10
9	SUBMITTALS.....	11
10	PROJECT COORDINATION.....	12
11	INSURANCE.....	12
12	QUALIFICATIONS AND LIMITATIONS.....	13

LIST OF ATTACHMENTS

ATTACHMENT 1.....	DRAWINGS
ATTACHMENT 2.....	PHOTOS

LIST OF FIGURES

Figure 1	Work Area 1
Figure 2	Work Area 2

ASBESTOS ABATEMENT WORK PLAN FORMER GAS ADMINISTRATION BUILDING 25 CIMINO DRIVE/101 CONEJOS COLORADO SPRINGS, COLORADO

1 INTRODUCTION

Walsh Environmental Scientists and Engineers, LLC. (WALSH) conducted an asbestos investigation from May 5 through June 1, 2009 at the former Gas Administration Building located at 25 Cimino Drive/101 Conejos in Colorado Springs, Colorado. The purpose of this investigation was to define a scope of work for removal of asbestos-containing materials (ACM) from the building and to assist in the decision-making with respect to removal of the materials prior to demolition.

2 ASBESTOS-CONTAINING MATERIALS

WALSH observed and studied the location and condition of asbestos-containing materials (ACM) to be removed. The following tables indicate the materials planned for removal as part of this project. Details of ACM sample results can be found online in the “Asbestos Demolition Inspection” for the building dated June 29, 2009.

3 GENERAL HAZARDOUS MATERIALS

WALSH inspected the site on October 29, 2009 for identification of general hazardous materials to be removed prior to demolition of the building(s). The building Owner plans to remove all identified hazardous materials prior to the start of abatement. However; if hazardous materials are discovered, the contractor shall be responsible for compliance with all applicable federal, state and local regulations governing the removal, handling, storage and transportation of hazardous materials including DOT requirements for transportation of hazardous materials on public thoroughfares. The Owner or representative will review all transportation manifests prior to hazardous materials leaving the site.

The Contractor shall at all times maintain a safe work environment, free from the possible effects of hazardous materials on the workers, building inhabitants, inspectors, and the Owner and its staff.

COLLECTION AND DISPOSAL OF PCB BALLASTS

PCB ballasts were not identified during the screening process; however, the following procedures will be used if discovered during completion of the project:

- A.** Contractor shall be responsible for training their own employees in the proper management of PCB wastes. If PCB's are to be transported on public roads, the Contractor shall be responsible for insuring that his employees are properly trained to comply with DOT shipping regulations.
- B.** Collect only PCB containing ballasts. Ballasts marked "No PCBs" or electronic ballasts may be discarded into the normal solid waste.
- C.** Do not touch the oil or tar leaking from PCB ballast. Contractor shall wear rubber gloves when handling leaking PCB ballasts.
- D.** Cut off the wires at the ballast to eliminate unnecessary disposal costs (based on weight). Remove the ballasts from the light fixture and place them into 55-gallon drums (DOT approved 1A2, 400 kg type) if they contain PCBs. Drum will be provided by Owner.
- E.** All drums (DOT approved 1A2, 400 kg type) shall be stored in a secured area as determined by the Owner under lock and key. All drums shall be labeled with appropriate EPA PCB warning label and DOT labels. Fill 55-gallon drums only half full to maintain drums at a manageable weight.
- F.** Contractor shall coordinate with Owner prior to drums with PCB ballasts being transported to Owner's off-site location.

COLLECTION AND DISPOSAL OF EXIT SIGNS WITH RADIOACTIVE MATERIALS

Radioactive exit signs were not identified during the screening process; however, the following procedures will be used if discovered during completion of the project:

- A.** Contractor is responsible for compliance with all applicable federal, state and local regulations. Contractor shall collect all exit signs containing radioactive hydrogen (tritium). These signs will have a radiation warning label (magenta and yellow label) if inspected carefully. The radioactive warning label is usually not visible unless the whole sign is removed from the wall. Contractor shall store all radioactive signs in a leak proof secondary container in a secure area determined by Owner under lock and key.
- B.** Contractor shall use caution when removing radioactive exit signs to avoid breaking the glass tubes inside the sign that hold the radioactive tritium.
- C.** Contractor shall notify WALSH IMMEDIATELY if sign breaks or is leaking.

- D. Contractor shall return radioactive signs to the manufacturer by obtaining approval and instructions for shipping. If the manufacturer will not accept the signs, contractor shall contact Colorado Springs Utilities Environmental Services for guidance.
- E. Contractor shall contact WALSH prior to shipping radioactive signs back to the manufacturer. Contractor shall provide documentation that radioactive signs were returned to the manufacturer.

COLLECTION AND DISPOSAL OF SMOKE DETECTORS

Smoke detectors identified during the inspection were not the type that contain radioactive material; however, the following procedures will be used if discovered during completion of the project:

- A. Contractor is responsible for compliance with all applicable federal, state and local regulations. Contractor shall inspect all smoke detectors. Contractor shall store the commercial smoke detectors in a leak proof secondary container in a secure area determined by Owner under lock and key.
- B. Contractor shall return the commercial smoke detectors to the manufacturer by obtaining approval and instructions for shipping. If the manufacturer will not accept the smoke detectors, contact Colorado Springs Utilities Environmental Services for guidance.
- C. Contractor shall notify WALSH prior to shipping commercial smoke detectors back to the manufacturer. Contractor shall provide documentation that radioactive materials were returned to the manufacturer.

COLLECTION AND DISPOSAL OF CHLOROFLUOROCARBONS (CFC's)

Equipment with CFCs were identified during the inspection. Approximate quantities are indicated in Table 4. The following procedures will be used for recapture and recycling of CFCs during the completion of the project:

- A. Contractor is responsible for compliance with all applicable federal, state and local regulations. The EPA standards for managing CFCs are found in 40 CFR part 82 (Protection of Stratospheric Ozone) and in 5 CCR 1001-19, Regulation No. 15. Contractor shall ensure CFC's are properly evacuated and collect CFCs from all refrigeration systems prior to removing air conditioning/refrigeration units. All personnel performing such work shall be certified pursuant to 40 CFR 82.161. Documentation of certified personnel shall be provided to WALSH. Documentation that refrigerant was removed shall be provided to WALSH.
- B. Contractor shall ensure removal of air conditioning/refrigeration units with care to prevent accidental release of CFCs into the atmosphere. Contractor shall coordinate with the Owner for removal of CFC's.

4 SCOPE OF WORK

The Scope of Work for this project is divided into at least 2 work areas and several “optional” areas. Tables 1 through 3 identify work areas designated by the City of Colorado Springs for ACM and general hazardous material removal. Removal includes proper disposal of all waste materials. The removal of hazardous materials from each building is included in the scope of work, including but not limited to; PCB ballasts, CFC’s, radioactive exit signs and smoke detectors. Refer to Drawings in Attachment 1 and Photos in Attachment 2 for further details regarding materials to be removed.

TABLE 1			
ASBESTOS TO BE REMOVED			
FORMER GAS ADMINISTRATION BUILDING			
WORK AREA	MATERIAL	ASBESTOS CONTENT	APPROXIMATE QUANTITY
1 Basement Perimeter Walls and Above Ceiling	Hard Packed Pipe Fittings	8% Chrysotile	50 Elbows
2 1st Floor Perimeter Walls Above Ceiling	Textured Surfacing on Walls	3% Chrysotile	72 SF
Optional 1st Floor	Gray 9-inch Floor Tiles Service Rm #3	17 % Chrysotile	375 SF
	Black 9-inch Floor Tiles W. Conference Rm	15 % Chrysotile	144 SF
	Light Brown 12-inch Floor Tile Main West Corridor	4 % Chrysotile	800 SF
	Red 9-inch Floor Tiles Dispatch Offices	7 % Chrysotile	45 SF
	Gray 9-inch Floor Tiles Center Conf. by Training Room	7 % Chrysotile	200 SF
	Tan 12-inch Floor Tiles Training Room	6 % Chrysotile	900SF
	Green 9-inch Floor Tiles Service Records and System Development Room	10 % Chrysotile	1,080 SF

SF-square feet

LF-linear feet

TABLE 2 ASBESTOS TO BE REMOVED (ALTERNATE 1) MODULAR BUILDING			
WORK AREA	MATERIAL	ASBESTOS CONTENT	APPROXIMATE QUANTITY
NO ACM IDENTIFIED			

Note: Building will be unoccupied during removal of ACM.

SF – square feet

LF – linear feet

TABLE 3 ASBESTOS TO BE REMOVED (ALTERNATE 2) WAREHOUSE			
WORK AREA	MATERIAL	ASBESTOS CONTENT	APPROXIMATE QUANTITY
Optional Exterior of Bldg	Caulk, white, rubbery	2% Chrysotile	240 LF

SF – square feet

LF – linear feet

TABLE 4 HAZARDOUS MATERIALS TO BE REMOVED	
MATERIAL TYPE	APPROXIMATE QUANTITY
Drinking Fountains (CFC's)	6 Drinking Fountains
Roof Mounted Air Conditioners (CFC's)	18 Units Containing R-22

1. The quantities identified herein are APPROXIMATE. The contractor is responsible for verifying actual material quantities and site conditions. The contractor must obtain all permits that are required to perform the work.
2. Work includes the removal and disposal of identified ACM.

3. Floor tiles and caulk listed as “Optional” may remain in the building during demolition if the contractor can keep them nonfriable and can dispose of them with demolition debris. Otherwise, the contractor has the option (at no additional cost to the owner) to remove the materials prior to demolition. If the contractor chooses to remove the materials all appropriate regulations must be followed.
4. Contractor will be responsible for the installation of water and electrical meters at the point of service on the property for use during abatement.
5. The contractor is responsible for moving any furniture, objects, carpet, fixtures, and any objects in the work area to access ACM for removal.
6. The contractor is responsible for verifying that heating and water pipes are isolated and drained prior to cutting.
7. The contractor is responsible for demolition to access ACM where scheduled for removal wherever necessary.
8. The removal of hazardous materials is included in the scope of work, including: PCB ballasts, CFC’s, radioactive exit signs and smoke detectors.
9. Buildings will be unoccupied during removal.

5 SCHEDULE

Work is scheduled will be specified by the City of Colorado Springs and included in the contract documents. Any costs incurred by the owner’s representative to be on site after the time indicated to complete the project will be the responsibility of the contractor. Costs include but are not limited to travel, lodging, analytical fees, per diem and professional fees.

6 WORK PROCEDURES

- The work areas contain non-friable and friable asbestos-containing materials and must be addressed accordingly. The following procedures must be followed at a minimum, but all work is to be performed according to Regulation No. 8 and all other applicable laws and regulations:
 - A. Pre-clean work areas where critical barriers will be applied. Construct and place critical barriers, impart a negative pressure differential between the work area and all surrounding areas, and put in place a fully operational decontamination unit contiguous with the work area. HEPA exhaust will be to the outside of the building in all work areas. Typical abatement enclosure diagrams are included in Attachment 2 as Figure 5.
 - B. All surfaces within a work area shall be thoroughly HEPA vacuumed and wet-wiped so that no visible dust or debris remains. All moveable objects must be removed from work area prior to containment construction by the contractor.
 - C. Proceed with containment construction, abatement and final clearance air monitoring in accordance with Regulation # 8, Section III.
- Each work area will be cleared utilizing phase contrast microscopy (PCM) as the analytical technique. All clearance air monitoring will be conducted according to Regulation No. 8. **If**

floor tile is removed as an option, then each area will require PCM clearance prior to demolition.

- Restrooms in buildings are not functional. The contractor must provide temporary restrooms at no additional cost to the Owner.
- Staging area for equipment and personnel will be at the closest entrance to each work area. A small truck for waste loadout may be parked at each entrance. Security for any equipment and/or trucks left onsite is the responsibility of the contractor. Owner will not be responsible for theft or vandalism of contractor's equipment left onsite.
- Keys for access may be available for after hour's work. Schedule any after hour's work with the Owner's representative(s).
- **The quantities identified herein are approximate. The contractor is responsible for verifying material quantities and site conditions. Any discrepancies or omissions must be brought to the attention of the owner prior to acceptance of project. By accepting a contract, contractor agrees with all conditions for completing the work including general work areas, quantities, schedules and procedures.**
- **Project hours** are listed below:

Hours will be 7:00 a.m. to 5:00 p.m., Monday-Friday unless otherwise coordinated with the building owner and Owner's representative(s).

7 INSPECTIONS BY OWNER/OWNERS REPRESENTATIVE

1. When required by Owner/Owners Representative, the Contractor shall take down or uncover portions of the finished work. If the work thus exposed is satisfactory to Owner/Owners Representative, the cost of exposing and restoring the same shall be at the expense of Owner/Owners Representative, but, if in opinion of Owner/Owners Representative, work is unsatisfactory, all cost and expenses of exposing, removing, re-testing, replacing and restoring shall be borne by the Contractor.
2. Any omission or failure on the part of Owner/Owners Representative to disapprove or reject any inferior or defective work or material shall not be construed to be an acceptance of any such work or materials. The Contractor shall remove at its own expense any defective work or material rejected by Owner/Owners Representative and shall rebuild or replace the same without extra charge to Owner/Owners Representative. All retesting of an area for clearance shall be at the Contractor's expense.
3. **All inspections (including clearance monitoring) shall take place during normal working hours.** If inspections occur past normal working hours, the Contractor shall bear the costs incurred by Owner/Owners Representative as result of the additional labor of Owner/Owners Representative.

4. Where the Owner/Owners Representative has an on-site representative, the Contractor shall give the Owner/Owners Representative two (2) hours advance notice of an impending inspection. Where the Owner/Owners Representative does not have an on-site representative, then a 24-hour advance notice of impending inspection is required.
5. If the inspection detects items to be corrected the area will be termed "failed" and will need to have corrective action taken by the Contractor.
6. The Contractor must allow for a two (2) hour notice period before the re-inspection of the failed area may begin (this may be waived by Owner/Owners Representative). Items of work requiring inspection sign-off by Owner/Owners Representative are:
 - a. Pre-Abatement (Area Preparation/Containment) Inspection. Removal of asbestos and necessary demolition shall not take place until Owner/Owners Representative has inspected area preparation work and given approval.
 - b. Final Visual Inspection - The area shall not be encapsulated or locked down until Owner/Owners Representative has inspected and given approval of the final cleaning and area decontamination. The containment must be completely dry, during the inspection with no water droplets, remains or saturation on polyethylene sheeting or other surfaces in the containment.
 - c. Contractor shall request in writing (via speed memo or fax) required Owner/Owners Representative inspections including the time and date of the requested inspection.
7. A punch list of items to be corrected resulting from the "failed" inspection, will be prepared jointly by the Contractor and Owner/Owners Representative prior to final acceptance of the project by the Owner/Owners Representative. Inspections shall in no way be construed as final or partial acceptance by Owner/Owners Representative. Any failure or omission of the Owner/Owners Representative to notify the Contractor of defective work shall not excuse Contractor for liability for such defective work.
8. It will be necessary that the Contractor successfully confine fiber release to the designated work area and within the enclosure. Owner/Owners Representative obligations are solely to Owner/Owners Representative. In meeting such obligations Owner/Owners Representative may increase the burdens and expense of the Contractor, his Sub-Contractors or employees, or the surety of them. Nothing in the performance of Owner/Owners Representative services in connection with this project implies the undertaking for the benefit of, or which may be enforced by, the Contractor, his Sub-Contractors, or employees, or the surety of any of them. It is not the function of Owner/Owners Representative to specify all of the means by which the Contractor will attain the intended results, nor to state all of the environmental conditions that must be present for the safety of workers who are employed to produce the intended results, or for the safety of others during construction. The Contractor shall establish means and environmental conditions that meet applicable laws and regulations.
9. The Contractor is required to remove all specified ACM. Any ACM, debris or contaminated materials, missed, not accessed or abated

thoroughly, and later discovered by the Owner/Owners Representative, will be corrected by the Contractor at no cost to the Owner/Owners Representative.

10. The Owner/Owners Representative will provide final visual inspection for all work areas and work Area Clearance sampling for each Phase (enclosure). Samples exceeding 0.010 f/cc will be deemed to have failed, and must be recleaned and retested (to avoid scheduling and cost implications associated with TEM analysis). Contractor may, on the approval of the Owner/Owners Representative, have failed clearance samples analyzed by TEM if it will not interfere with the project schedule. Cost for TEM analysis will be responsibility of the contractor.

8 MAXIMUM ALLOWABLE ASBESTOS LEVEL (MAAL)

Outside Work Area: If any air sample taken outside of the Work Area exceeds the CDPHE Maximum Allowable Asbestos Level (MAAL), immediately and automatically stop all work except corrective action. The Owner/Owners Representative will determine the source of the high reading and so notify the Contractor in writing.

1. Maximum Allowable Asbestos Level
 - a. Air monitoring shall be conducted during normal occupancy and samples shall not be collected in an aggressive manner.
 - b. Where PCM is used as the method of analysis the standard is 0.01 fibers per cubic centimeter of air (f/cc) which is equivalent to 10,000 fibers per cubic meter of air (f/m³). The NIOSH 7400 Method shall be used to analyze samples. The number of samples to be taken shall be determined by the certified air monitoring specialist. Where TEM is used as the method of analysis, the standard is 70 structures/millimeter² (s/mm²). TEM analysis shall be conducted pursuant to the protocol in 40 C.F.R. Part 763, Appendix A to Subpart E (EPA 1995).
 - c. All air monitoring collected for MAAL and Clearance purposes shall be performed by the Owner's representative who is independent of the abatement contractor to avoid possible conflict of interest.
2. In the event that airborne fiber levels outside a Work Area exceed the MAAL when analyzed by PCM (when verified by TEM), the Contractor shall comply with CDPHE requirements for Major Asbestos Spills (Regulation 8 III.T). If the high reading was the result of a failure of Work Area isolation measures initiate the following additional actions:
 - a. Immediately erect new critical barriers to isolate the affected area from the balance of the building. Erect Critical Barriers at the next existing structural isolation of the involved space (e.g. wall, ceiling, floor).
 - b. Decontaminate the affected area.
 - c. Require that respiratory protection be worn in affected area until area is cleared for re-occupancy.
 - d. Leave Critical Barriers in place until completion of work and insure that the operation of the pressure differential system in the Work Area results in a flow of air from the balance of the building into the affected area.
 - e. If the exit from the clean room of the personnel decontamination unit enters the affected area, establish a decontamination facility consisting of a Shower Room and Changing at entry point to affected area.
 - f. After Certification of Visual Inspection in the Work Area remove critical barriers separating the work area from the affected area. Final air samples will be taken within the entire area.
3. In the event that areas beyond the work area become contaminated with asbestos, asbestos-containing dust/debris, and/or visible emissions from the work area, the Contractor shall be responsible for all costs associated with

cleaning and subsequent testing (visual inspection, air sampling and bulk analysis) of these areas.

4. If the high reading was the result of other causes initiate corrective action as required by the applicable regulations at the direction of the Owner.

Effect on Contract Sum: Complete corrective work with no change in the Contract Sum if high airborne fiber counts were caused by Contractor's activities. The Contract Sum and schedule will be adjusted for additional work caused by high airborne fiber counts beyond the Contractor's control. Contractor is responsible for all costs associated with TEM verification where PCM samples exceed 0.010 f/cc, and any subsequent cleaning and additional sampling costs regardless of TEM sample results.

9 SUBMITTALS

Plan of Action

Prepare a brief plan of the procedures proposed for use in complying with the requirements of this work plan and all applicable regulations. Include in the plan the general locations and layouts of decontamination areas, the sequencing of asbestos work (containments and work areas), methods to be used to assure the safety of building occupants and visitors to the site, disposal plan including staging and waste loadout procedures, and location of approved disposal site. Expand upon the use of HEPA ventilation system (number and locations), closing out of the building's HVAC and electrical systems, and method of removal to prohibit visible emissions. The Contractor is solely responsible for construction means, methods, techniques and sequences, and procedures with respect to complying with applicable regulations.

Technical Submittals

The contractor shall submit all technical documentation as specified in this section using the list and schedule provided below.

<u>Pre-start Submittals</u> (Minimum five days prior)	<u>Daily Submittals</u>	<u>Contract Closeout</u> (Two weeks after)
<ul style="list-style-type: none">• Respiratory Protection Program• Hazard Communication Program• Medical Response Program• General Abatement Certificate• Insurance Certificate• Workers Compensation Insurance• Automotive Insurance Certification• Performance and Payment Bonds (with Bid Form))• List of Personnel Used	<ul style="list-style-type: none">• Daily Field Logs• Daily Entry/Exit Sign-in Sheets• Visitor Documentation Forms• Event Condition Report• 24-hour Manometer Chart• Air Monitoring Results• Accident Reports• Photographs	<ul style="list-style-type: none">• Disposal Manifests• Owner's Final Inspection• Change Orders• Final Punchlist Document

- Personnel Certifications
- Project Design (Plan of Action)
- Project Sequencing and Schedule
- Disposal Facility Information

10 PROJECT COORDINATION

The intent of this project is to remove most asbestos-containing materials prior to a planned demolition of the structure(s). Since demolition is also included in the project, some nonfriable ACM may be left in the building(s) and disposed of with demolition debris. It is expected that, at a minimum, tar impregnated materials that are identified in the Demolition Inspection will be left in the building(s) during demolition. These materials may include tar impregnated shingles, felts, mastics and rubberized caulks to the extent that they remain nonfriable during demolition.

Floor tiles may be removed at the Contractor's option since removal will be dependent on Contractor's means and methods of removal. Coordination of removal shall include informal meetings with the Owner's representative(s) and onsite representatives such as the following:

-Informal Pre-construction Conference to be convened by the Contractor prior to start of any work. The conference will be scheduled before start of construction, at a time convenient to the Owner and Owner representative(s), but no later than the day of the start of the project. Meet at the project site, or as otherwise directed. Authorized representatives of Owner will be in attendance. An authorized representative of the Contractor and its project supervisor and other concerned parties shall attend the conference. All participants at the conference shall be familiar with the Project and authorized to conclude matters relating to the Work. Contractor will document the meeting and distribute meeting minutes no later than three days after the meeting. Identification of optional removal items will be discussed at this time, as well as scheduling implications.

-Project Closeout- Before requesting final inspection for certification of final acceptance and final payment, a project punchlist must be completed and accepted by Owner. The punchlist shall state that each item has been completed or otherwise resolved for acceptance and shall be endorsed and dated by Owner.

11 INSURANCE

The Contractor shall procure and maintain insurance as indicated by contract documents. Insurance shall include Comprehensive General Public Liability and Property Damage Insurance, Worker's Compensation Insurance and Comprehensive Automobile Liability and Property Damage Insurance as hereinafter specified, at his own expense, during the life of this contract. This insurance shall include a provision preventing cancellation within a specified number of days and shall state whether the coverage is "claims made" or "occurrence made". The Contractor shall obtain "occurrence or claims made" insurance as specified in the contract documents. A completed Certificate of Insurance shall be filed with the owner after the date of the Notice of Award, said

Certificate to specifically state the inclusion of the coverage and provisions set forth in the contract documents.

12 QUALIFICATIONS AND LIMITATIONS

WALSH completed this investigation and work plan in a manner consistent with current professional practices. The assessment was limited to sampling locations and analyses described in the report provided by the client. No other sampling or analyses were conducted during this investigation. Only readily accessible spaces were inspected; therefore, it is possible that ACM may exist in areas that were inaccessible during the building inspection and walk through. If suspect materials are encountered, it is possible that additional reports or investigations could alter the conclusions of this assessment.

Procedures are prepared for use by the contractor, but do not limit the contractor from performing its work according to any regulations not included in this document.

This report is intended for use only by the client or its designees. Any future use of this report by anyone other than the above-referenced client will require authorization by WALSH.


ATTACHMENT 1

ASBESTOS ANALYTICAL RESULTS

**(SEE “ASBESTOS DEMOLITION INSPECTION” REPORT
DATED JUNE 29, 2009 ONLINE
(WWW.SPRINGSGOV.COM/RFP.ASPX)**



ATTACHMENT 2

DRAWINGS

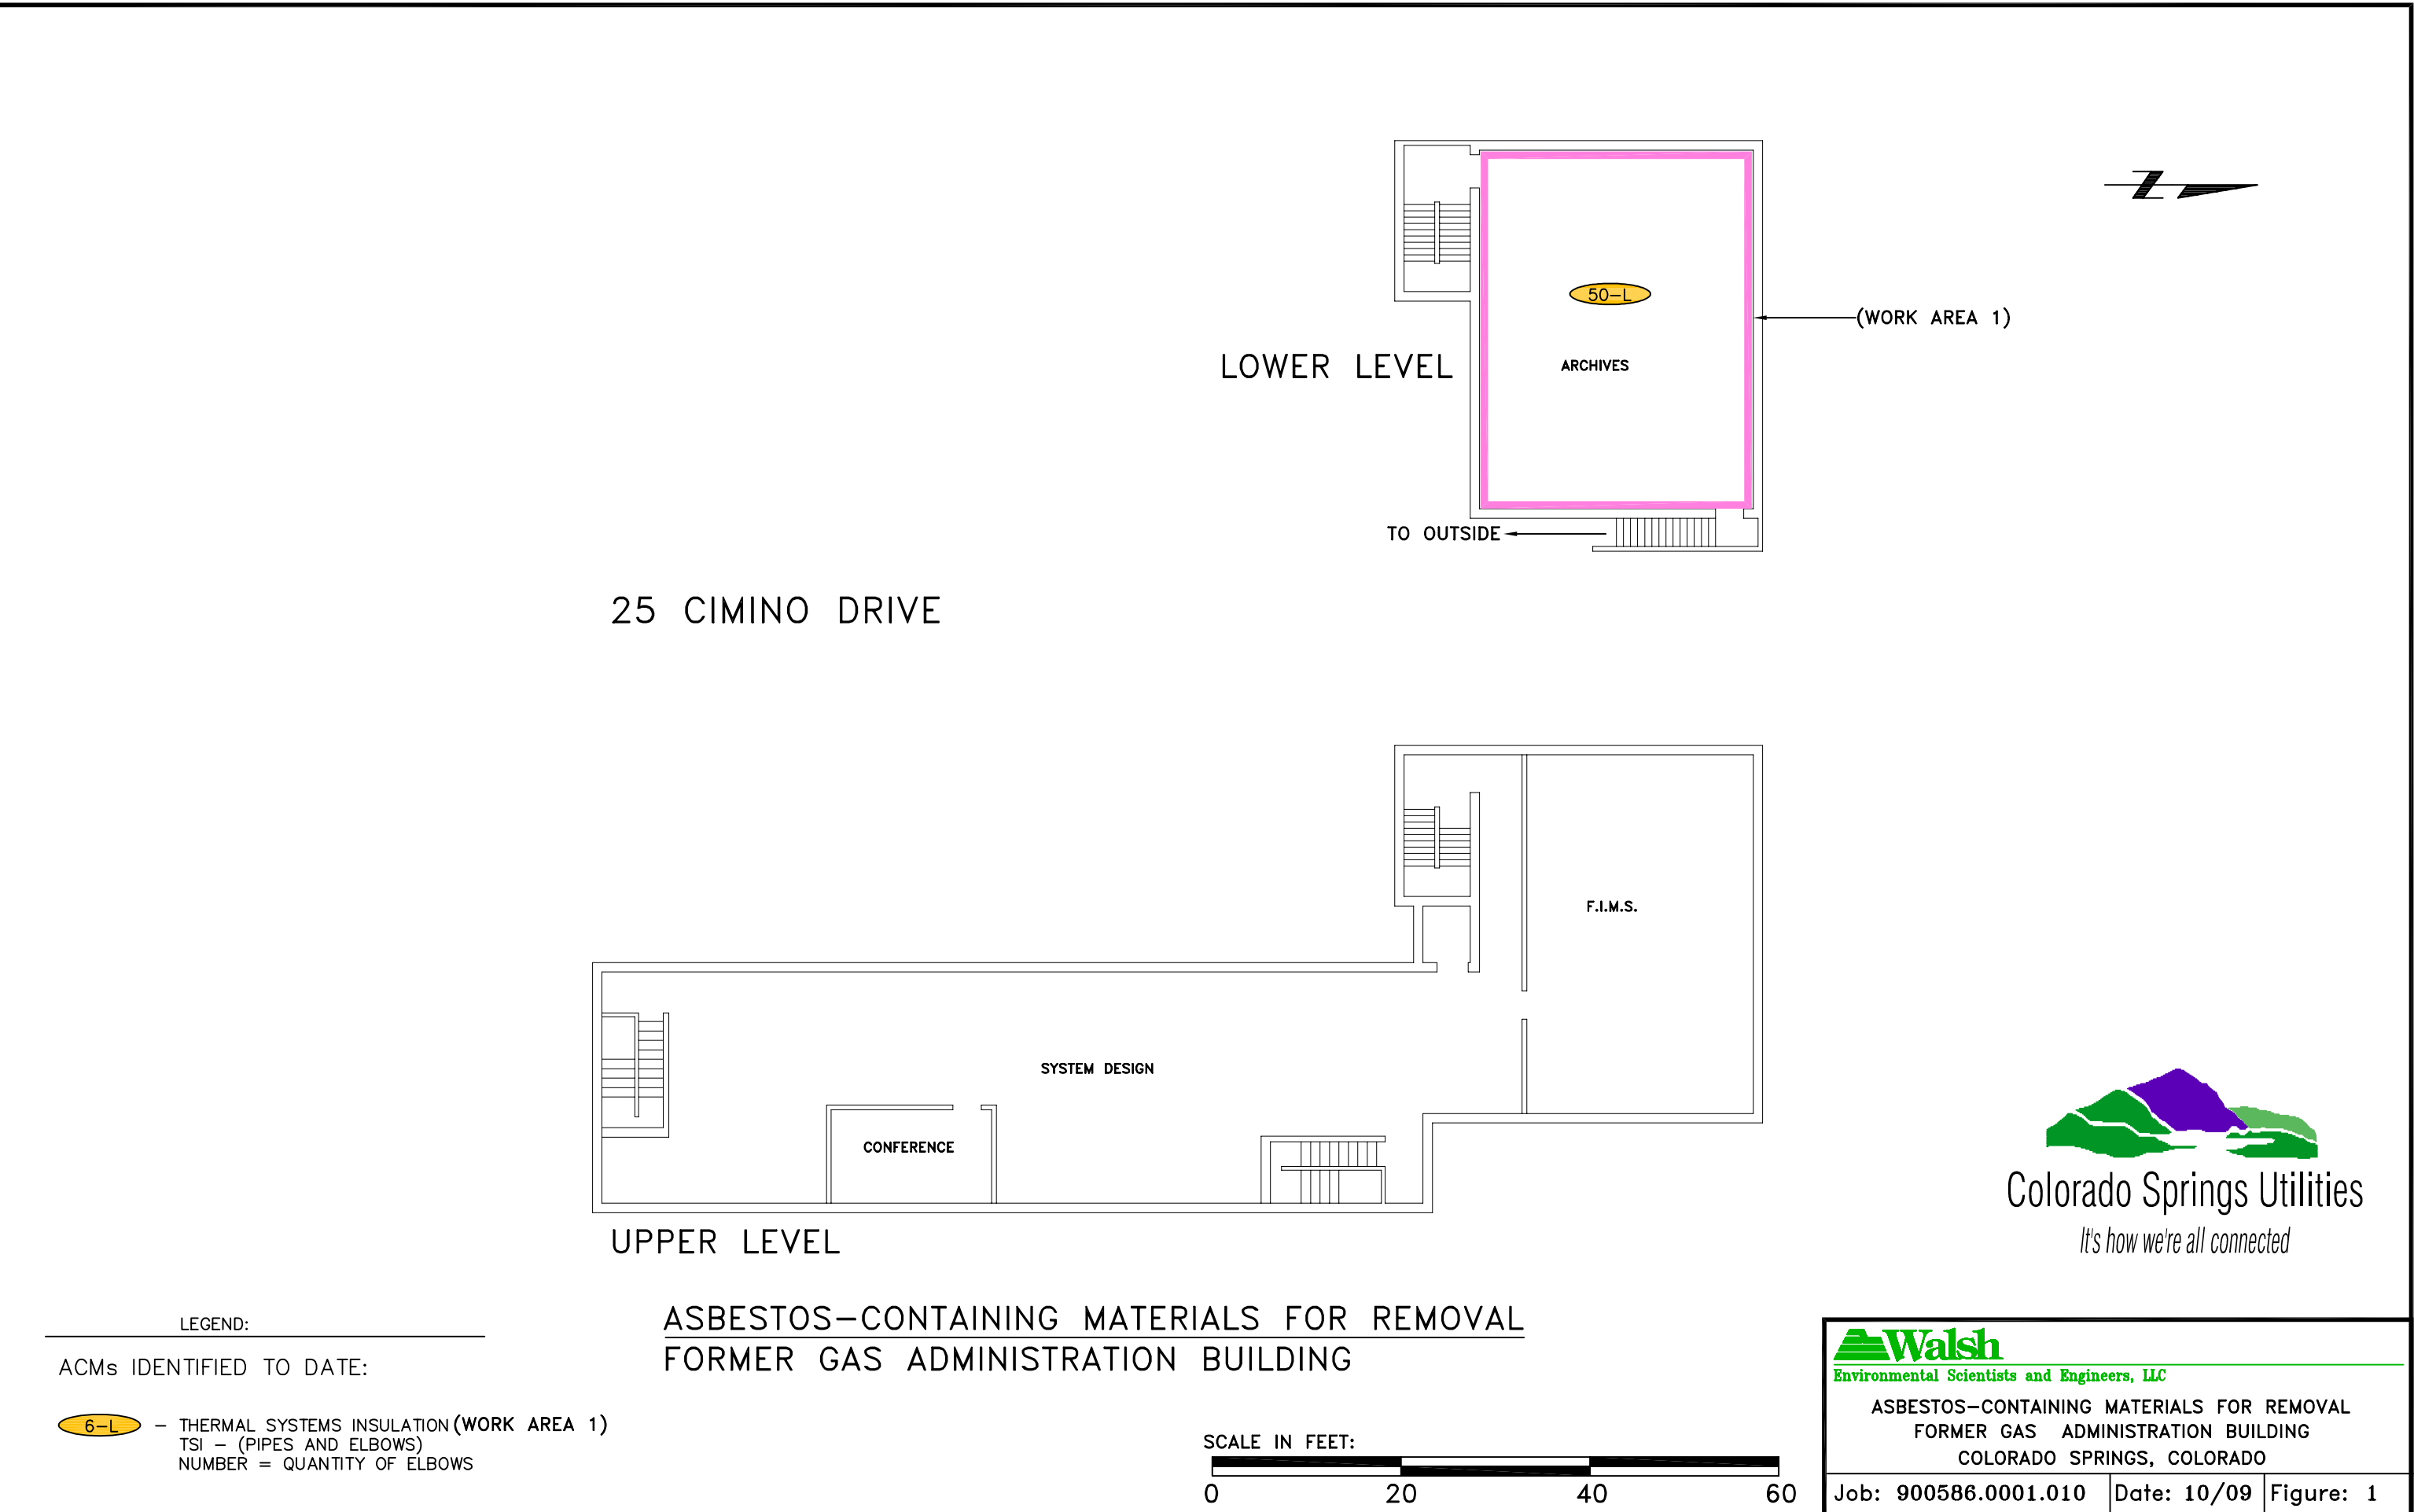

25 CIMINO DRIVE

LOWER LEVEL

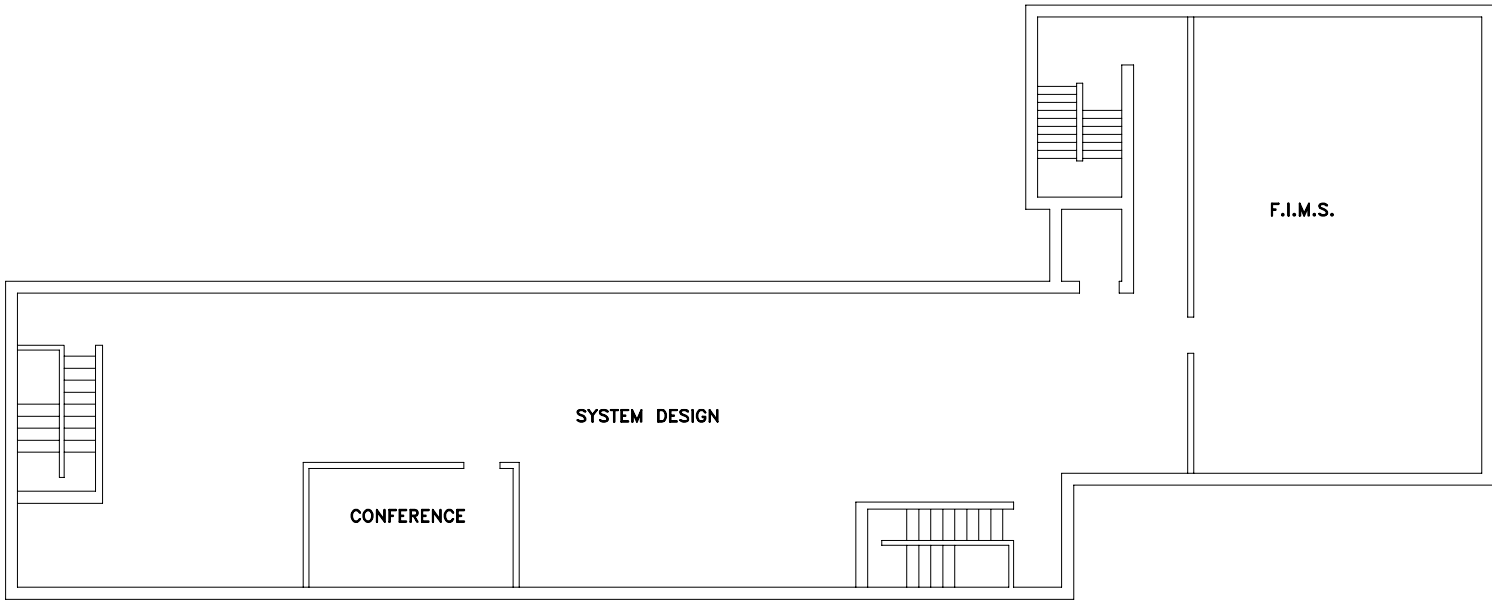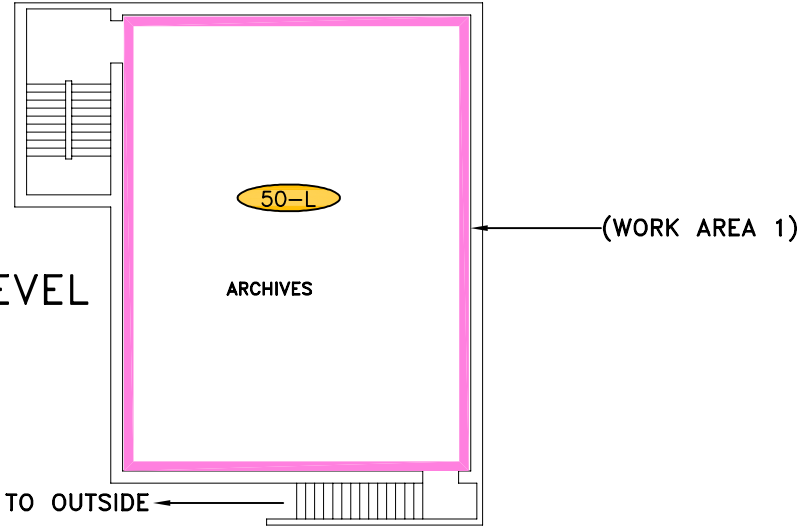

UPPER LEVEL



**ASBESTOS-CONTAINING MATERIALS FOR REMOVAL
FORMER GAS ADMINISTRATION BUILDING**

LEGEND:
ACMs IDENTIFIED TO DATE:
6-L - THERMAL SYSTEMS INSULATION (WORK AREA 1)
TSI - (PIPES AND ELBOWS)
NUMBER = QUANTITY OF ELBOWS




Walsh
Environmental Scientists and Engineers, LLC

ASBESTOS-CONTAINING MATERIALS FOR REMOVAL
FORMER GAS ADMINISTRATION BUILDING
COLORADO SPRINGS, COLORADO

Job: 900586.0001.010	Date: 10/09	Figure: 1
----------------------	-------------	-----------

MAIN LEVEL

WORK AREA 2



25 CIMINO DRIVE

(FLOOR TILE OPTIONAL)
(OPTIONAL)
(TO REMAIN)
(WORK AREA 2)

ASBESTOS-CONTAINING MATERIALS FOR REMOVAL
FORMER GAS ADMINISTRATION BUILDING



ASBESTOS-CONTAINING MATERIALS FOR REMOVAL
FORMER GAS ADMINISTRATION BUILDING
COLORADO SPRINGS, COLORADO

Job: 900586.0001.010 | Date: 10/09

ATTACHMENT 3

PHOTOS



Photo 1 – View of gray floor tile containing 17% Chrysotile.



Photo 2 – View of brown floor tile containing 4% Chrysotile.



Photo 3 – View of roofing shingles containing 15% Chrysotile.



Photo 4 – View of roofing tar and felt containing 20 % and 10% Chrysotile respectively.

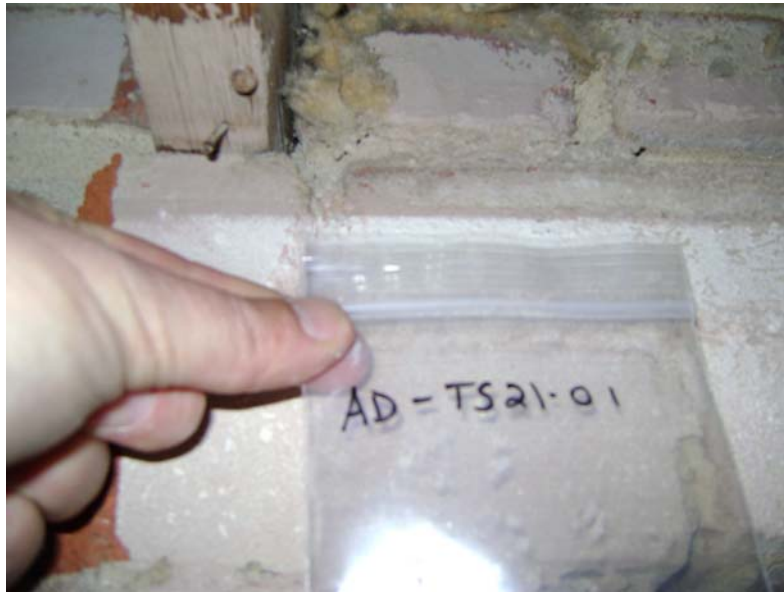


Photo 5 – View of ceiling texture overspray on wall containing 3% Chrysotile.



Photo 6 – View of hard-packed pipe fittings containing 8% Chrysotile.